

DATE: _____

COMPANY: _____


JOB NAME: _____

SUBMITTED BY: _____

NOTES: _____

**FLUSH MOUNT FLEX DUCT CONCENTRIC KIT
SUBMITTAL DATA FOR:
CARRIER UNITS
48GS 018-042; 48GX, 024-036; 50JS,
JZ 018-042; 48/50 XP 024-036;
45/50 SD 024-036; 50 SZ 024-030
SEE ALSO BRYANT UNITS**

BRYANT UNITS
574A 024-030;
574B 024-036;
583A 024-036;
582ANW 018-042;
601A, 701A 018-042;
602A, 602B, 702A,
702B 024-036;
604A, 704A 024-030;
604B, 704B 024-036;
604C, 704C 024-030

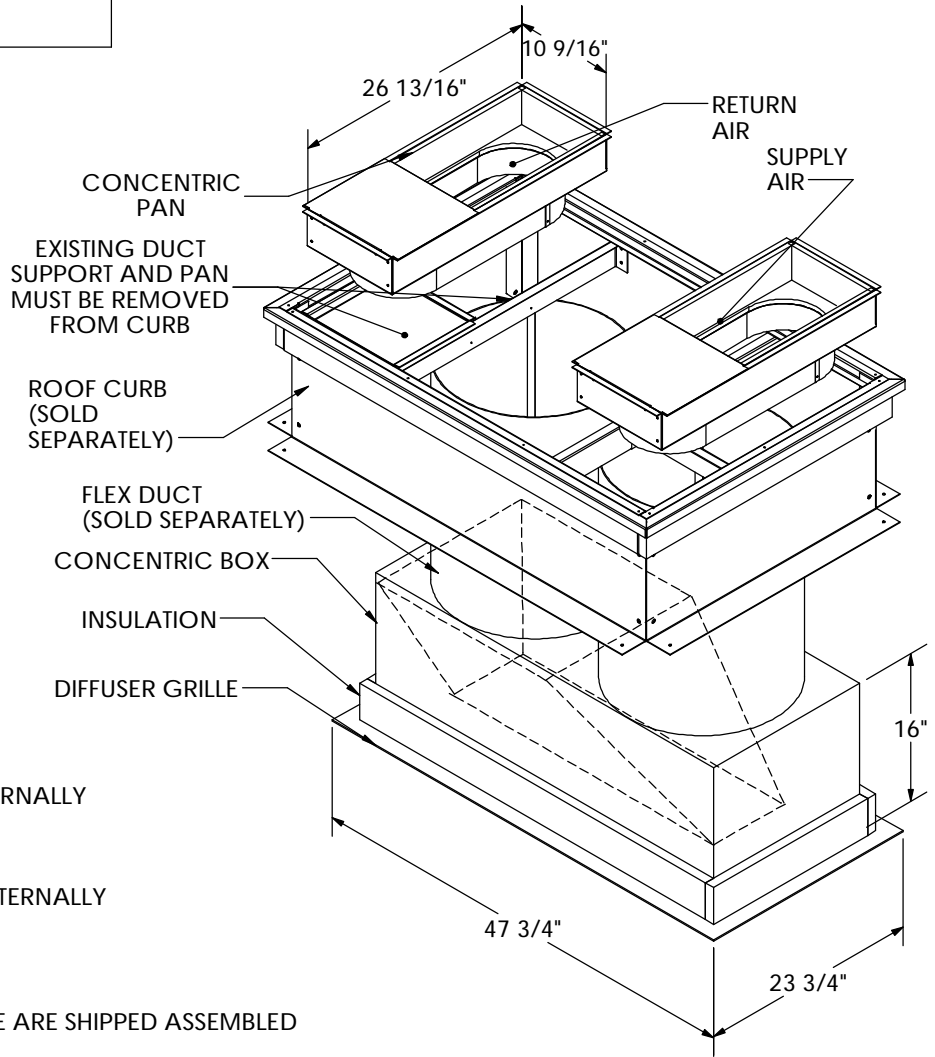

FEATURES:

CONCENTRIC PANS ARE INSULATED INTERNALLY AND SHIPPED ASSEMBLED

CONCENTRIC BOX IS CONSTRUCTED OF GALVANIZED STEEL AND IS INSULATED INTERNALLY

FLUSH MOUNT PAINTED DIFFUSER GRILLE WITH FIXED BLADES

CONCENTRIC BOX AND DIFFUSER GRILLE ARE SHIPPED ASSEMBLED

CAMBRIDGEPORT PART NUMBER	DUCT SIZE	APPLICABLE CURB MODEL NUMBERS	FLEX (SOLD SEPARATELY)	NOMINAL CFM	THROW IN FT.	
					MIN	MAX
1010970	2 @ 18"	CPRFCURB007A000P	1000080 (2-18")	600-1400	11	26

NOTES:

- 1 - INSTALL INSULATED ADAPTER PANS BEFORE A/C UNIT IS PLACED ON CURB.
- 2 - FIELD BAFFLES MAY BE REQUIRED FOR BALANCING
- 3 - CONCENTRIC BOX MUST BE FIELD SUPPORTED

Drawn By: CJT
 Date: 12/13/07 Rev: 0
 KML 1/7/10 Rev 1

Cambridgeport

AIR SYSTEMS

MEMPHIS, TN 38118

PHONE 1-877-648-2872 FAX 901-566-0035

SALISBURY, MA 01952

PHONE 1-800-648-2872 FAX 978-462-9189